


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:


MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

DATA OF LAMP		Imax(cd)	3595	S/MH(C0/180)	1.27
MODEL		EFFICIENCY(%)	100.0	S/MH(C90/270)	1.26
NOMINAL POWER(W)	60	TOTAL FLUX(lm)	8491.6	Voltage(V)	219.8
RATED VOLTAGE(V)	220	EFFICIENCY(lm/W)	142.4	Current(A)	0.278
NOMINAL FLUX(lm)	8491.7	η up(%)	3.5	Power(W)	59.63
LAMPS QUANTITY	1	η down(%)	96.5	Power Factor(PF)	0.973
TEST VOLTAGE(V)	219.8	Effective Flux(lm)	7858.1	EEI	0.103

LUMINOUS INTENSITY DISTRIBUTION

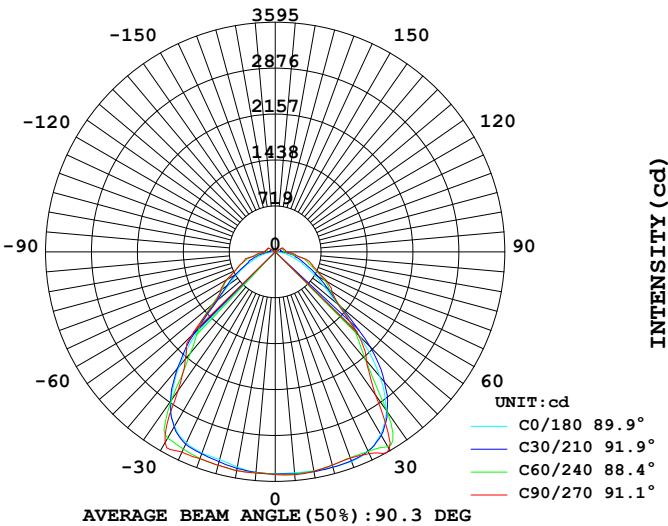

LUMINOUS INTENSITY DISTRIBUTION

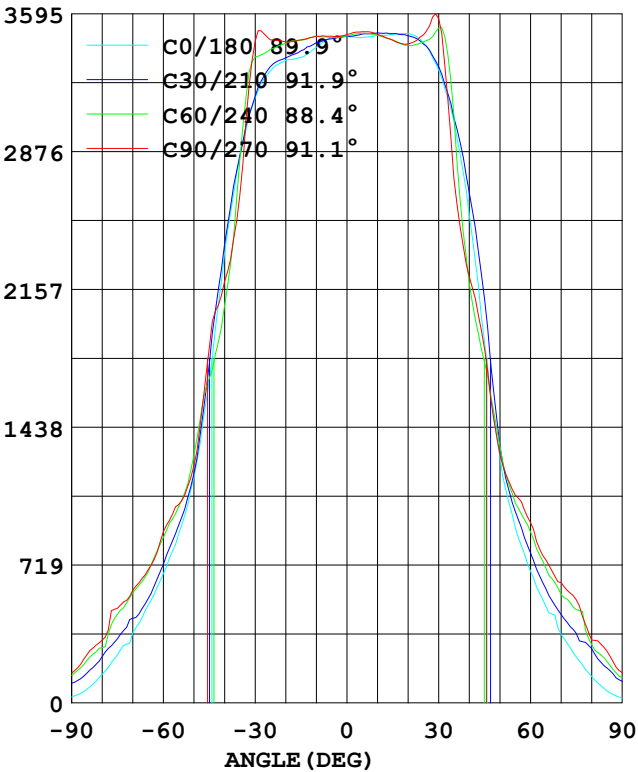

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日


Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

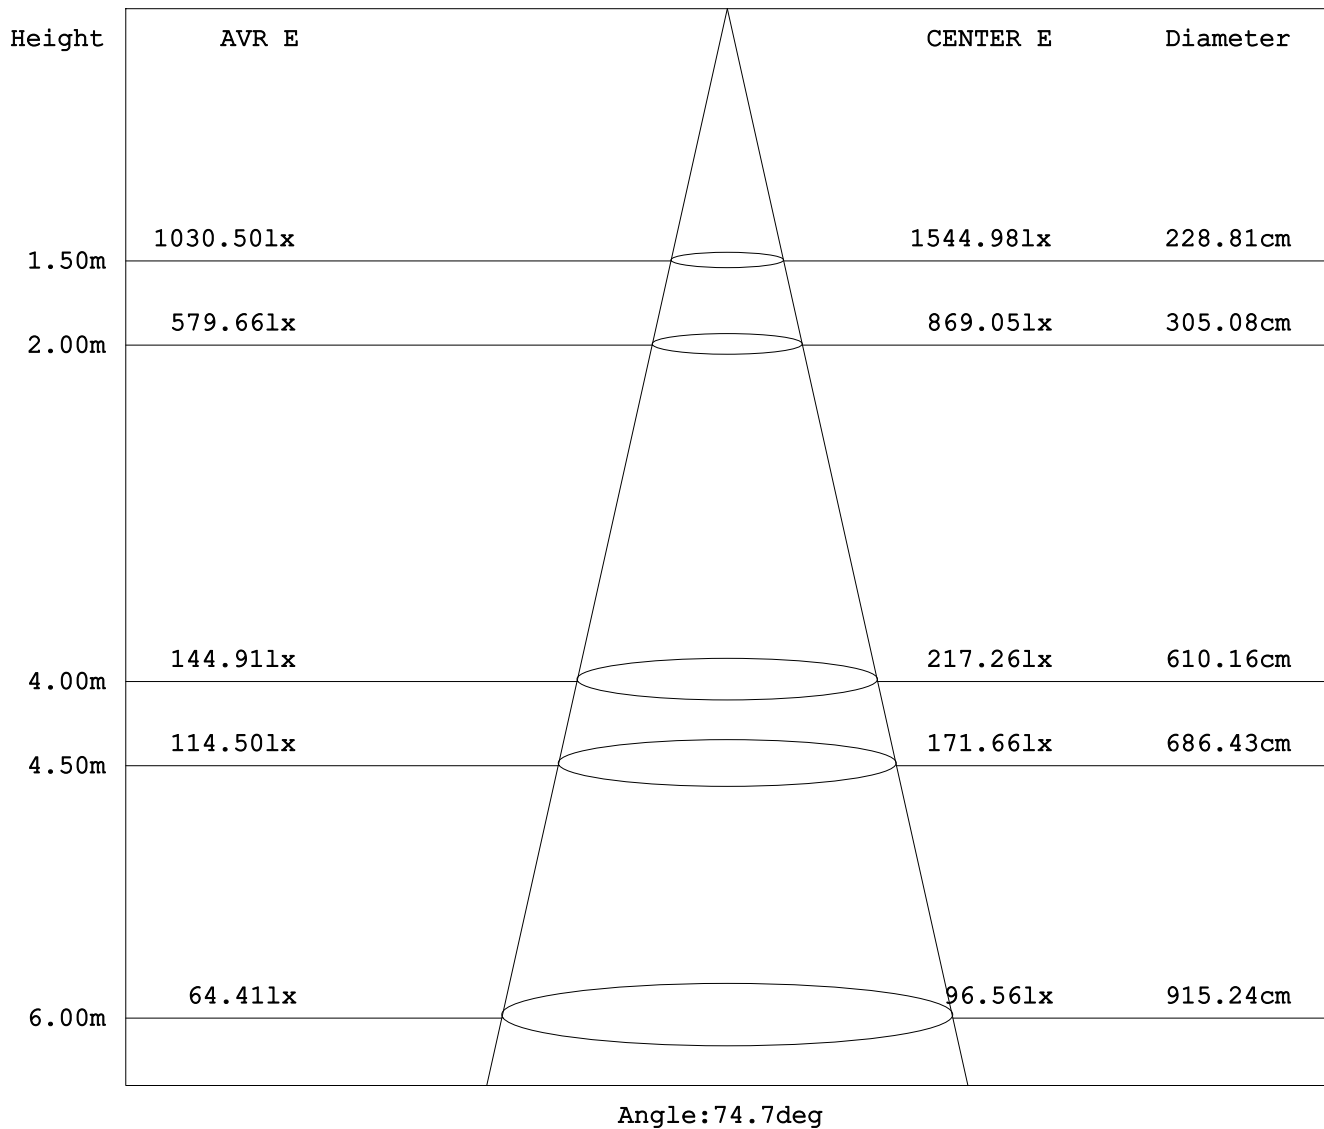

Test System: HOPOO HPG1800
Temperature: 25.3DEG
Operators:
Test Date: 2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity: 65.0%
Test Distance: 11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	zOne	total
5.0	3470	3468	3478	3467	3471	3492	3502	3489	0- 5	83.19	83.19
10.0	3420	3460	3479	3461	3482	3489	3489	3465	5- 10	248.5	331.7
15.0	3368	3430	3459	3468	3488	3475	3457	3414	10- 15	409.9	741.7
20.0	3352	3403	3449	3471	3493	3456	3438	3374	15- 20	566.3	1308
25.0	3297	3364	3459	3447	3444	3442	3485	3325	20- 25	716.9	2025
30.0	3156	3266	3449	3353	3302	3421	3570	3234	25- 30	854.9	2880
35.0	2848	2846	2652	3131	3037	3059	2736	2995	30- 35	934.3	3814
40.0	2345	2231	2198	2447	2546	2424	2223	2277	35- 40	878.2	4693
45.0	1685	1730	1853	1781	1876	1940	1845	1692	40- 45	764.0	5457
50.0	1179	1245	1238	1349	1285	1341	1298	1306	45- 50	617.1	6074
55.0	881.4	975.3	1034	1008	916.2	1022	1084	1001	50- 55	489.8	6564
60.0	674.0	793.1	893.1	767.8	687.6	837.9	941.0	775.4	55- 60	412.4	6976
65.0	507.7	611.4	693.6	603.9	505.5	650.3	746.8	611.2	60- 65	340.8	7317
70.0	366.1	508.6	587.3	470.7	359.2	514.6	627.9	476.1	65- 70	279.4	7596
75.0	250.3	398.5	493.9	358.5	238.2	424.4	537.3	378.4	70- 75	227.5	7824
80.0	148.7	265.1	327.7	243.4	139.2	294.5	328.7	259.8	75- 80	173.4	7998
85.0	71.75	188.0	250.5	171.8	62.55	199.2	270.3	175.9	80- 85	117.3	8115
90.0	31.09	122.6	155.8	109.2	25.77	122.0	157.1	107.2	85- 90	75.40	8190
95.0	21.41	117.0	162.8	101.9	17.42	119.8	170.4	100.5	90- 95	57.58	8248
100.0	19.23	104.1	151.0	88.51	15.85	109.6	158.3	91.71	95-100	52.53	8300
105.0	18.99	106.6	139.6	89.66	16.81	109.9	148.7	94.31	100-105	50.10	8351
110.0	20.44	104.8	133.2	88.99	19.23	110.1	138.6	92.32	105-110	48.51	8399
115.0	21.65	99.28	131.2	86.09	20.93	105.9	135.6	89.78	110-115	45.96	8445
120.0	22.99	91.17	126.9	83.18	24.44	102.0	128.7	86.15	115-120	42.63	8488
125.0	0	0	0	0	0	0	0	0	120-125	4.048	8492
130.0	0	0	0	0	0	0	0	0	125-130	0	8492
135.0	0	0	0	0	0	0	0	0	130-135	0	8492
140.0	0	0	0	0	0	0	0	0	135-140	0	8492
145.0	0	0	0	0	0	0	0	0	140-145	0	8492
150.0	0	0	0	0	0	0	0	0	145-150	0	8492
155.0	0	0	0	0	0	0	0	0	150-155	0	8492
160.0	0	0	0	0	0	0	0	0	155-160	0	8492
165.0	0	0	0	0	0	0	0	0	160-165	0	8492
170.0	0	0	0	0	0	0	0	0	165-170	0	8492
175.0	0	0	0	0	0	0	0	0	170-175	0	8492
180.0	0	0	0	0	0	0	0	0	175-180	0	8492
DEG	LUMINOUS INTENSITY:cd									UNIT:lm	

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:


HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

LUMINANCE LIMITATION CURVES

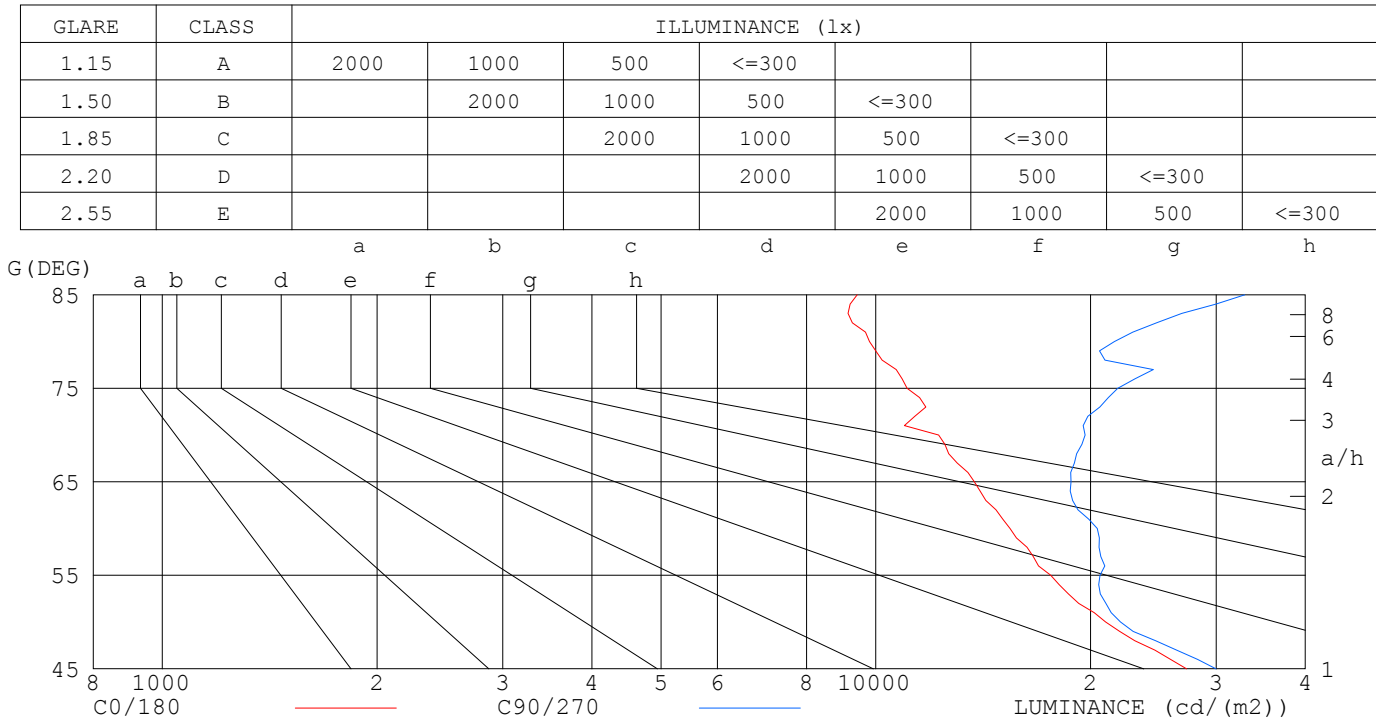

LUMINANCE cd/ (m2)		
G (DEG)	C0/180	C90/270
85	9420	32897
80	9798	21598
75	11067	21835
70	12249	19648
65	13746	18781
60	15425	20437
55	17584	20625
50	20993	22036
45	27264	29989


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

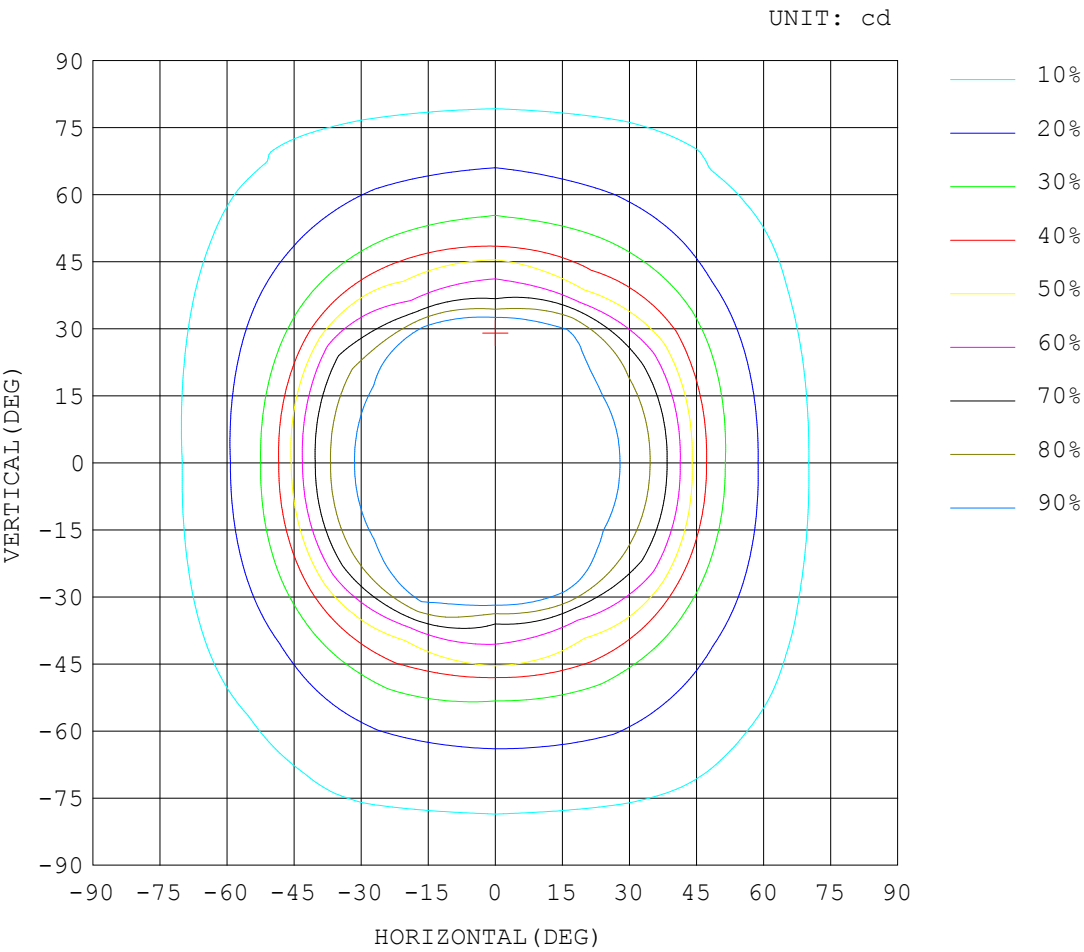

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日


Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

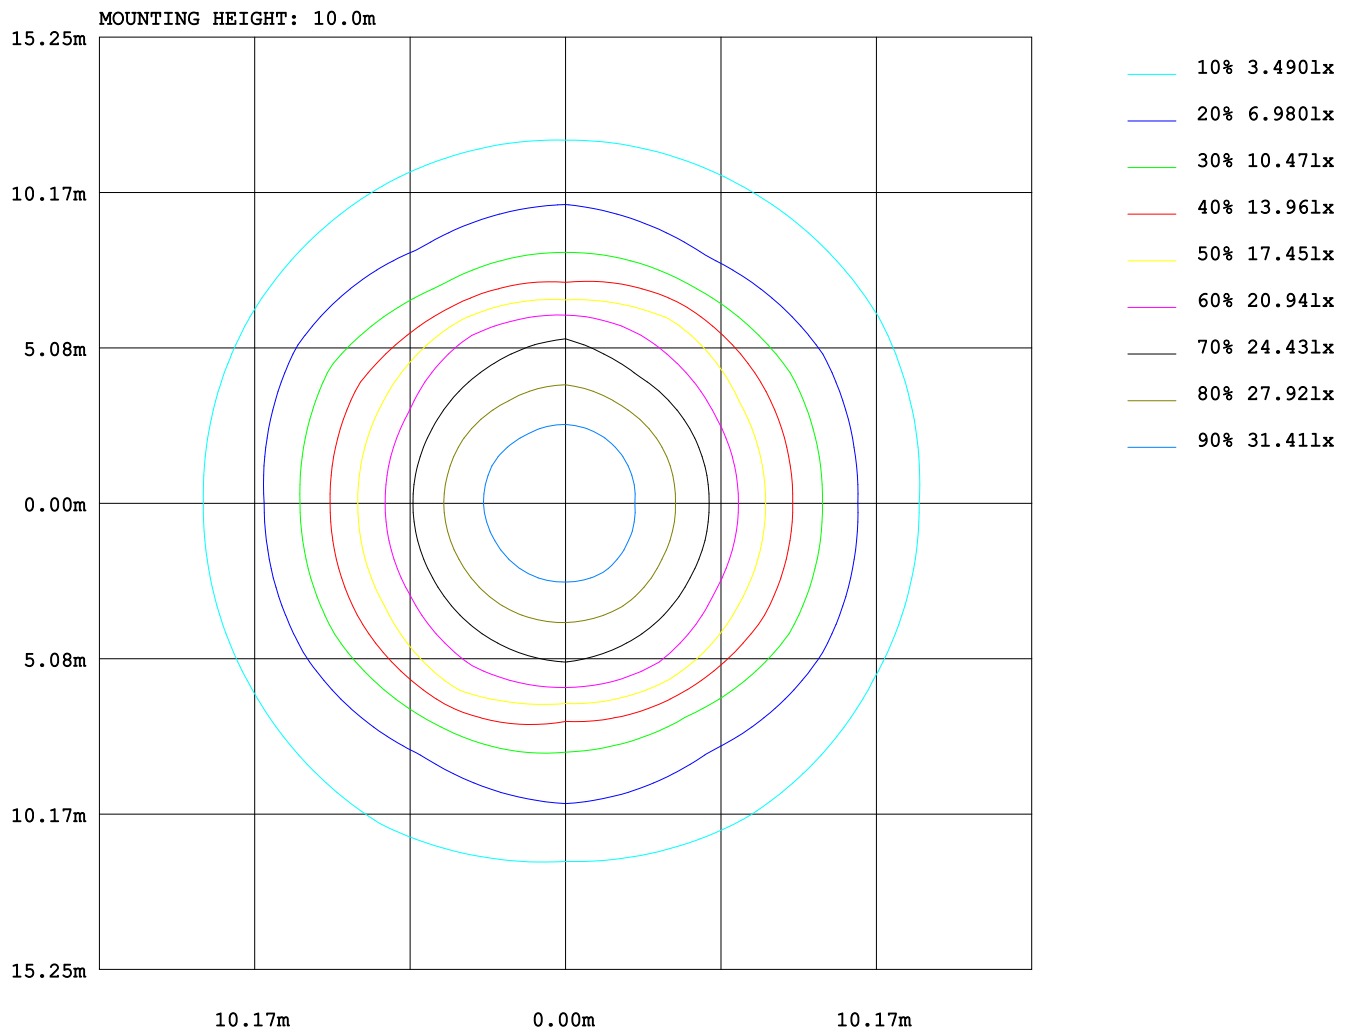

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

AREA LUMINOUS FLUX

Report number:

MANUFACTURER:																				
Address:																				
NAME: RE-RIP5S5-72N1WD-B4-TR										TYPE:					WEIGHT:					
SPECIFICATION:										DIMENSION: 1450*67mm					SERIAL No.:					

VERTICAL (DEG)	AREA FLUX DIAGRAM																		UNIT:lm			Φ t	Φ a
	0.13	0.64	1.57	2.68	3.73	4.79	5.84	6.82	7.57	7.51	6.64	5.56	4.41	3.29	2.26	1.31	0.57	0.13	65.4	0.00			
90																							
80	0.15	0.87	2.33	4.39	6.71	9.48	12.1	13.9	15.1	14.9	13.3	11.2	8.65	5.95	3.69	1.97	0.78	0.15	126	83.9			
70	0.17	1.11	3.23	6.17	9.83	13.8	17.7	20.6	22.5	22.3	20.1	16.8	12.8	8.87	5.36	2.76	1.01	0.17	186	168			
60	0.19	1.39	3.96	7.82	12.9	19.3	25.5	30.2	32.9	32.7	29.7	24.6	18.1	12.1	7.13	3.58	1.27	0.19	264	253			
50	0.21	1.62	4.74	9.77	17.2	26.4	37.3	47.2	53.5	52.6	44.6	35.5	25.7	15.9	9.09	4.41	1.53	0.22	388	380			
40	0.23	1.81	5.52	11.9	22.3	40.4	59.1	75.0	85.3	85.2	75.1	55.0	37.0	21.6	11.1	5.22	1.75	0.24	595	588			
30	0.24	1.95	6.18	14.0	29.7	59.5	83.6	101	106	104	96.9	80.4	53.2	27.9	13.3	5.91	1.93	0.25	787	782			
	0.24	2.03	6.63	15.7	37.3	70.1	92.0	102	105	104	98.7	88.0	64.8	33.6	15.0	6.43	2.03	0.26	843	839			
	0.24	2.03	6.81	16.5	40.9	74.2	94.2	102	106	105	99.4	90.4	69.6	36.8	15.7	6.67	2.06	0.26	870	865			
	0.24	2.01	6.75	16.4	40.3	74.1	94.1	102	105	105	99.4	90.4	69.5	36.7	15.6	6.67	2.06	0.26	867	863			
	0.24	1.96	6.47	15.3	35.8	69.1	91.7	102	105	105	99.6	88.0	64.4	33.0	14.8	6.43	2.05	0.26	841	836			
-30	0.23	1.83	5.93	13.4	28.6	56.3	84.3	99.8	105	104	97.5	78.1	52.6	26.4	13.3	5.91	1.97	0.25	776	771			
-40	0.21	1.63	5.19	11.0	21.4	38.4	58.5	78.0	84.3	81.8	70.6	54.5	36.2	20.5	11.2	5.26	1.81	0.24	581	575			
-50	0.19	1.40	4.24	8.98	15.8	25.9	37.1	46.4	52.9	52.6	45.7	35.7	25.0	16.1	9.02	4.59	1.58	0.22	384	376			
-60	0.17	1.15	3.31	6.89	11.9	18.0	24.5	29.3	31.5	31.3	29.0	24.8	18.5	12.1	7.41	3.79	1.32	0.20	256	244			
-70	0.15	0.90	2.49	4.96	8.61	12.7	16.6	19.4	21.1	21.2	19.8	17.3	13.4	9.43	5.75	2.93	1.04	0.17	178	160			
-80	0.13	0.67	1.73	3.36	5.60	8.31	10.9	12.8	14.1	14.2	13.1	11.3	8.80	6.14	3.88	2.05	0.79	0.15	118	73.4			
-90	0.11	0.49	1.12	2.04	3.23	4.59	5.78	6.62	7.24	7.28	6.74	5.96	4.86	3.59	2.41	1.38	0.60	0.13	64.2	0.00			
-90 -80 -70 -60 -50 -40 -30 -20 HORIZONTAL (DEG) 20 30 40 50 60 70 80 90																							
Φ t	3.46	25.5	78.2	172	352	626	852	996	1060	1052	967	814	588	331	166	77.3	26.2	3.75	8492				
Φ a	0.00	0.00	51.5	149	334	609	835	979	1042	1034	950	797	571	312	144	49.6	0.00	0.00		7858			

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:


HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Report number:

MANUFACTURER:															
Address:															
NAME: RE-RIP5S5-72N1WD-B4-TR								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION: 1450*67mm				SERIAL No.:			

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

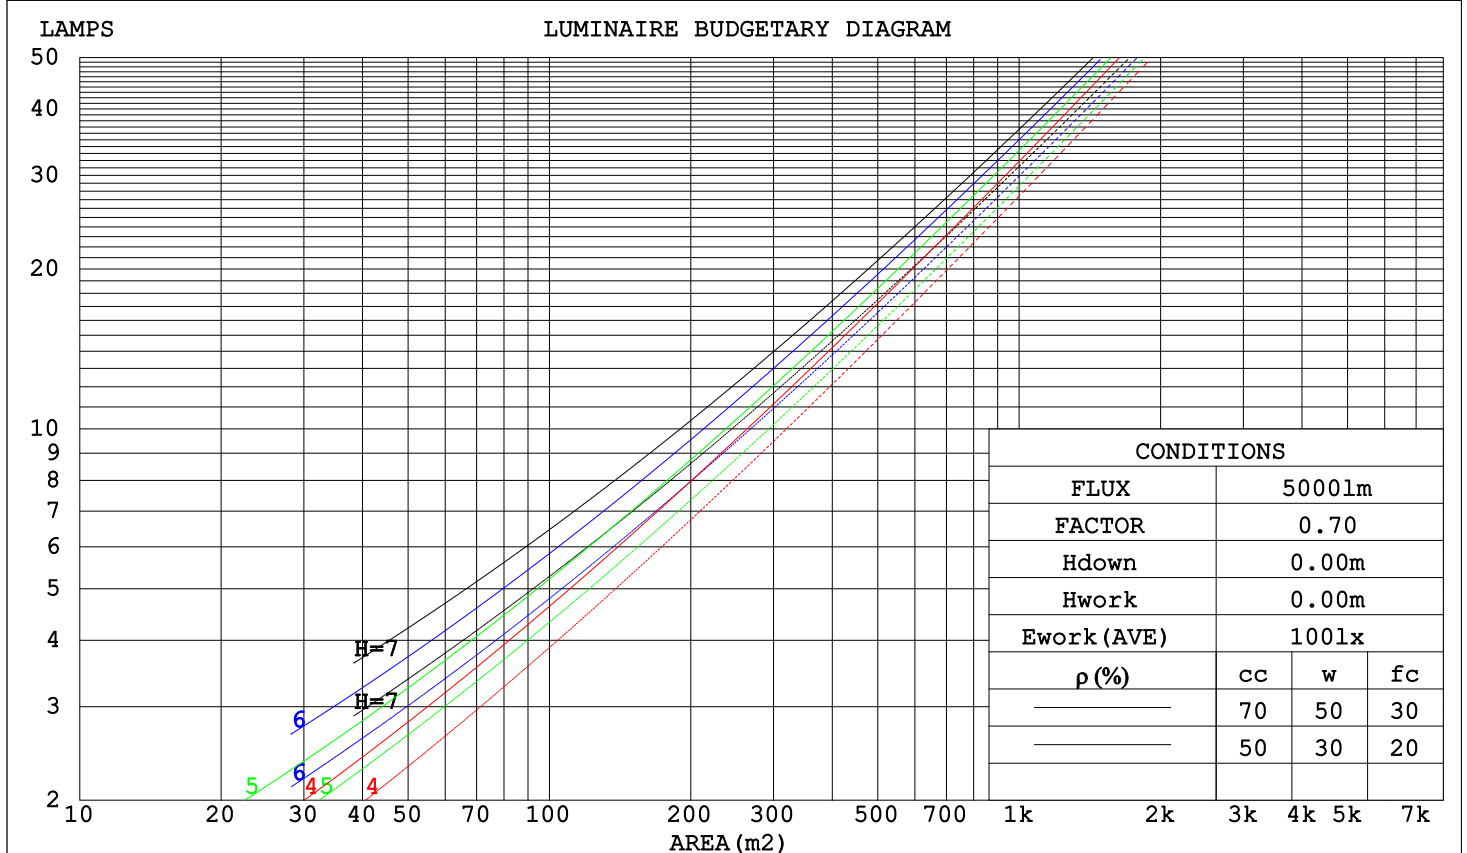

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

Report number:

MANUFACTURER:															
Address:															
NAME: RE-RIP5S5-72N1WD-B4-TR								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION: 1450*67mm				SERIAL No.:			

ρ_{cc}	80%			70%			50%			30%			10%			0														
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
ρ_{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.282	.160	.051	.274	.156	.050	.259	.148	.047	.245	.141	.045	.232	.134	.043															
2.0	.262	.144	.044	.255	.141	.043	.242	.135	.042	.230	.129	.040	.218	.123	.039															
3.0	.243	.129	.039	.237	.127	.038	.225	.122	.037	.214	.117	.036	.204	.113	.035															
4.0	.226	.117	.034	.220	.115	.034	.210	.111	.033	.200	.107	.032	.191	.104	.032															
5.0	.210	.107	.031	.205	.105	.031	.196	.102	.030	.187	.099	.029	.179	.096	.029															
6.0	.196	.098	.028	.192	.097	.028	.184	.094	.027	.176	.091	.027	.168	.089	.026															
7.0	.184	.091	.026	.180	.090	.026	.172	.087	.025	.165	.085	.025	.159	.082	.024															
8.0	.173	.084	.024	.169	.083	.024	.162	.081	.023	.156	.079	.023	.150	.077	.022															
9.0	.163	.079	.022	.160	.078	.022	.153	.076	.022	.148	.074	.021	.142	.072	.021															
10.0	.154	.074	.020	.151	.073	.020	.145	.071	.020	.140	.070	.020	.135	.068	.019															

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.218	.218	.218	.186	.186	.186	.127	.127	.127	.073	.073	.073	.023	.023	.023	
1.0	.206	.184	.164	.176	.158	.141	.120	.108	.098	.069	.063	.057	.022	.020	.018	
2.0	.196	.160	.129	.168	.137	.112	.115	.095	.078	.066	.055	.046	.021	.018	.015	
3.0	.187	.142	.106	.160	.122	.092	.110	.085	.064	.064	.050	.038	.020	.016	.012	
4.0	.179	.128	.090	.153	.111	.078	.106	.077	.055	.061	.045	.032	.020	.015	.011	
5.0	.171	.118	.078	.147	.102	.068	.101	.071	.048	.059	.042	.028	.019	.014	.009	
6.0	.164	.109	.070	.141	.094	.061	.097	.066	.043	.057	.039	.025	.018	.013	.008	
7.0	.158	.102	.063	.136	.089	.055	.094	.062	.039	.054	.037	.023	.018	.012	.008	
8.0	.152	.096	.058	.131	.084	.051	.090	.059	.036	.053	.035	.022	.017	.011	.007	
9.0	.146	.091	.055	.126	.079	.048	.087	.056	.034	.051	.033	.020	.016	.011	.007	
10.0	.141	.087	.052	.121	.076	.045	.084	.053	.032	.049	.031	.019	.016	.010	.006	

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:11.000 m
 Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

Uncorrected UGR Table

Report number:

MANUFACTURER:											
Address:											
NAME: RE-RIP5S5-72N1WD-B4-TR					TYPE:			WEIGHT:			
SPECIFICATION:					DIMENSION: 1450*67mm			SERIAL No.:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	21.9	23.3	22.2	23.5	23.8	22.6	23.9	22.9	24.2	24.4	
	22.7	23.9	23.0	24.2	24.5	23.9	25.2	24.3	25.4	25.7	
	23.1	24.2	23.4	24.6	24.9	24.7	25.9	25.1	26.2	26.5	
	23.3	24.4	23.7	24.8	25.1	25.4	26.5	25.8	26.8	27.2	
	23.4	24.5	23.8	24.8	25.2	25.7	26.8	26.1	27.1	27.5	
	23.5	24.5	23.9	24.8	25.2	26.1	27.2	26.5	27.5	27.9	
4H	2H	22.3	23.5	22.7	23.8	24.1	22.9	24.1	23.3	24.4	24.7
	3H	23.4	24.4	23.8	24.8	25.1	24.6	25.6	25.0	25.9	26.3
	4H	23.9	24.9	24.4	25.2	25.6	25.6	26.5	26.0	26.9	27.3
	6H	24.4	25.2	24.8	25.6	26.0	26.4	27.2	26.8	27.6	28.1
	8H	24.5	25.3	25.0	25.7	26.2	26.8	27.6	27.3	28.0	28.5
	12H	24.6	25.3	25.1	25.8	26.3	27.3	28.0	27.8	28.5	29.0
8H	4H	24.4	25.1	24.8	25.6	26.0	25.8	26.6	26.3	27.0	27.4
	6H	25.0	25.6	25.5	26.1	26.6	26.8	27.4	27.3	27.9	28.4
	8H	25.3	25.8	25.8	26.3	26.9	27.4	28.0	27.9	28.4	29.0
	12H	25.5	26.0	26.1	26.5	27.1	28.1	28.6	28.6	29.1	29.6
12H	4H	24.4	25.1	24.9	25.6	26.1	25.8	26.5	26.3	26.9	27.4
	6H	25.2	25.7	25.7	26.2	26.7	26.9	27.4	27.4	27.9	28.4
	8H	25.5	26.0	26.1	26.5	27.1	27.5	28.0	28.1	28.5	29.1
Variations with the observer position at spacings:											
S = 1.0H	+ 0.4 / - 0.5					+ 0.2 / - 0.3					
1.5H	+ 0.4 / - 0.4					+ 0.1 / - 0.2					
2.0H	+ 0.7 / - 0.5					+ 0.2 / - 0.4					

CIE Pub.117 Corrected 8492 lm Total Lamp Luminous Flux. (8log(F/F0) = 7.4)

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:11.000 m
 Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

UTILIZATION FACTORS TABLE

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	64	53	47	63	53	47	62	53	47	41
0.80	73	63	56	72	63	56	70	62	56	50
1.00	81	71	64	80	70	64	77	71	64	57
1.25	87	78	71	86	77	71	83	75	70	63
1.50	91	83	77	90	82	76	87	80	75	68
2.00	97	90	84	95	88	83	92	86	81	74
2.50	100	94	88	98	92	87	94	89	85	77
3.00	103	97	92	101	95	91	97	92	88	80
4.00	107	102	97	104	100	96	100	96	93	83
5.00	109	104	101	106	102	99	101	98	95	86
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2022年09月16日


Test Set: 10.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:11.000 m
 Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

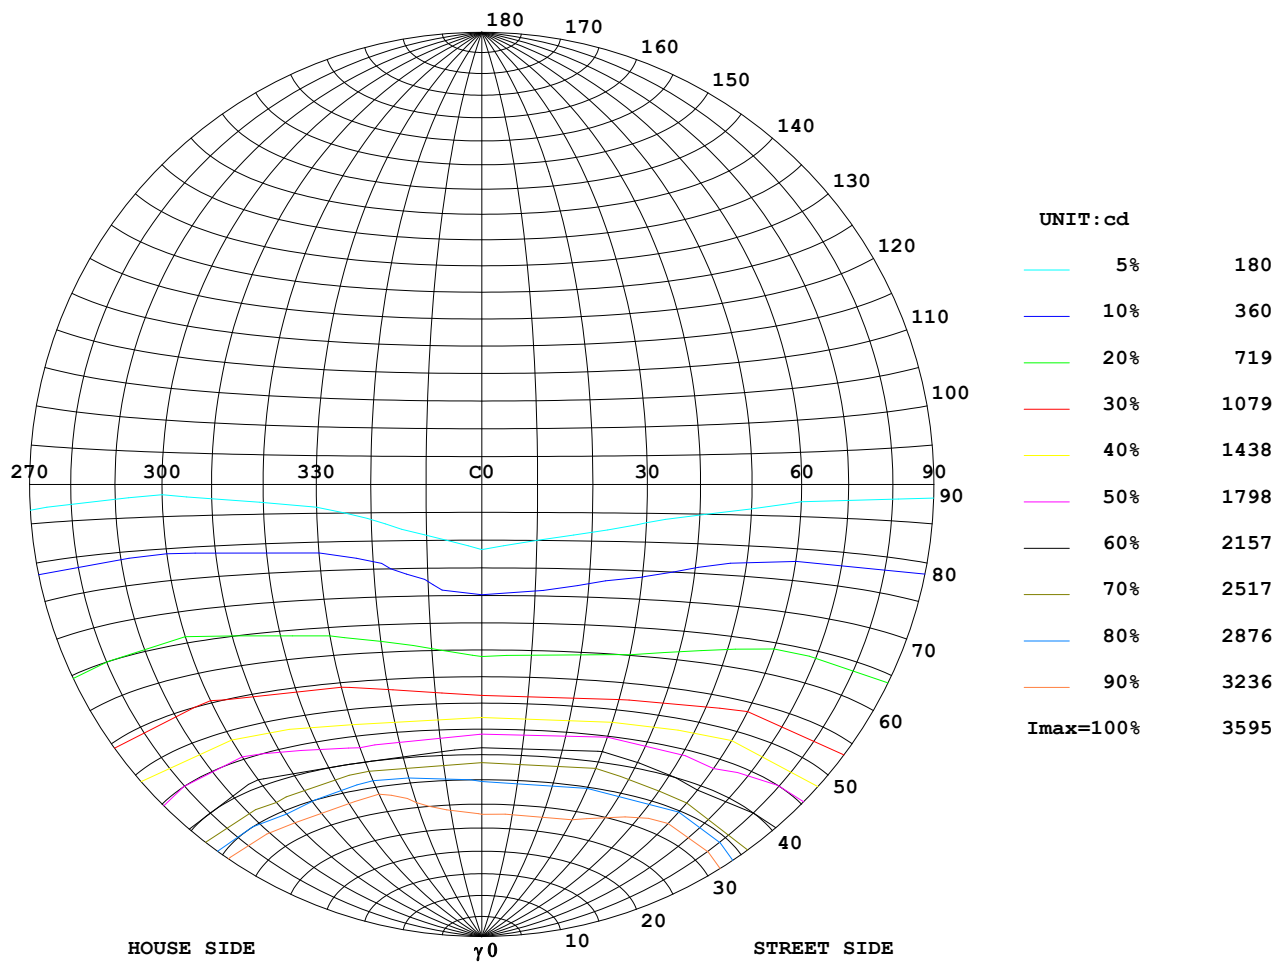

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:



HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

ILLUMINANCE AT MH=10 m,Enadir = 34.76 lx

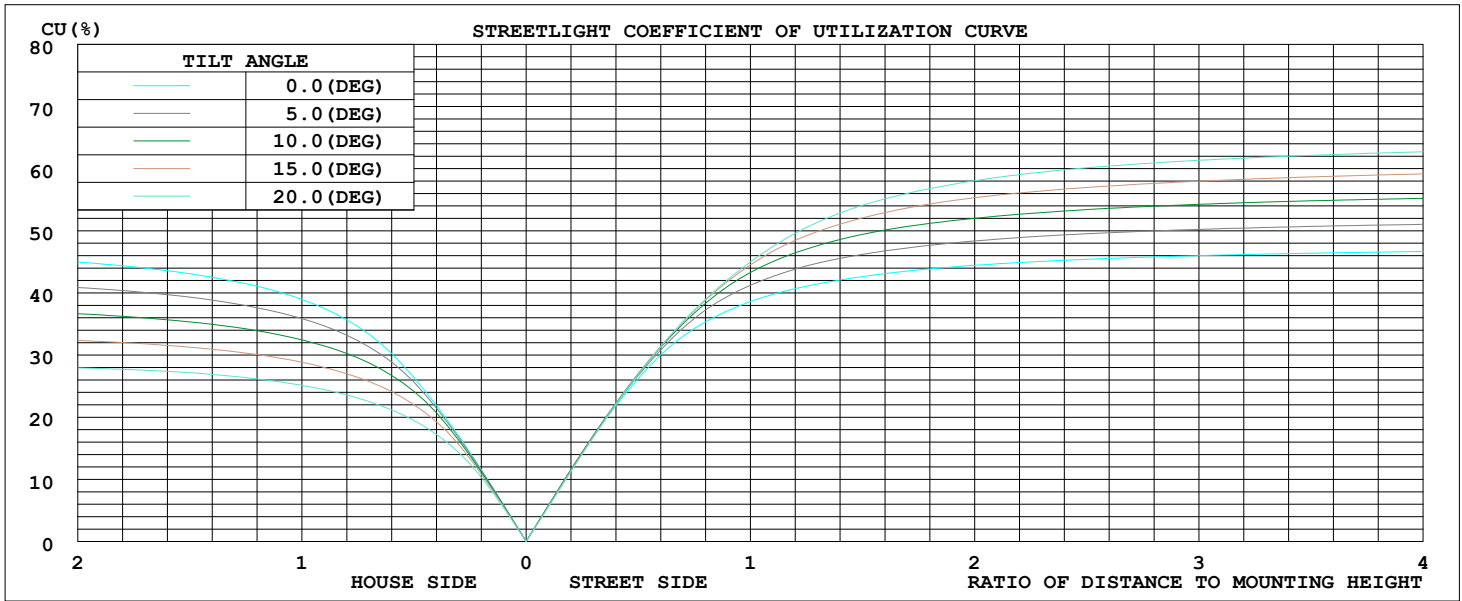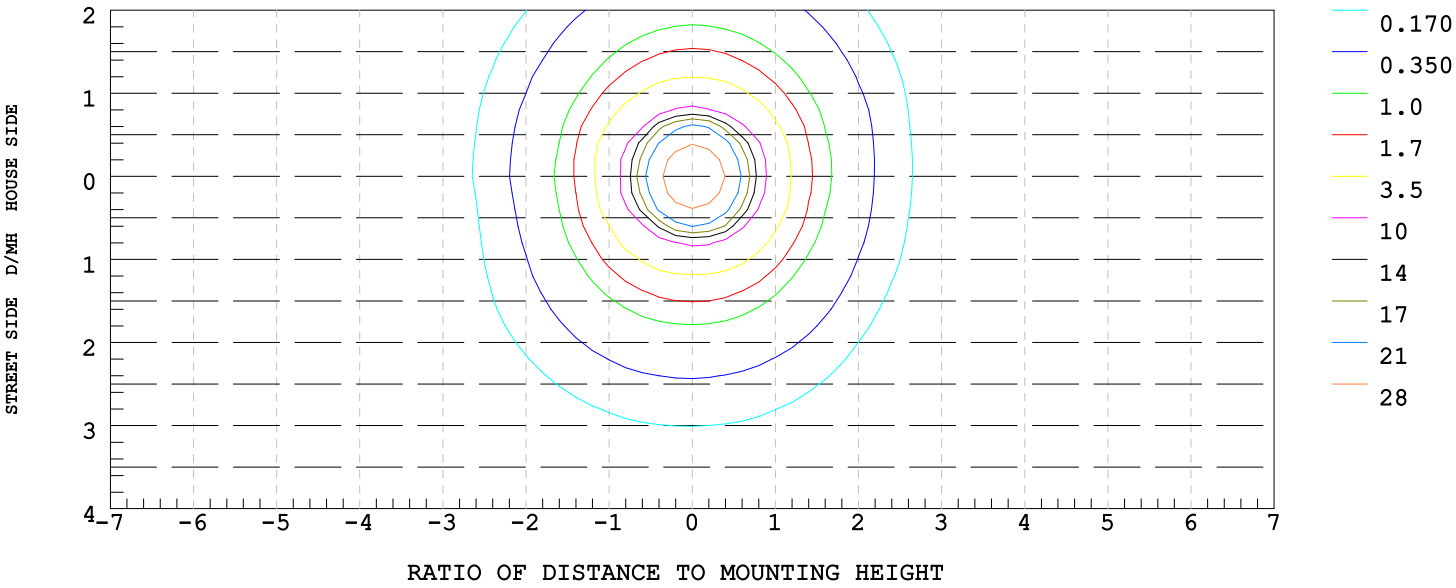

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日


Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks:

HOPOO GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: RE-RIP5S5-72N1WD-B4-TR	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION: 1450*67mm	SERIAL No.:

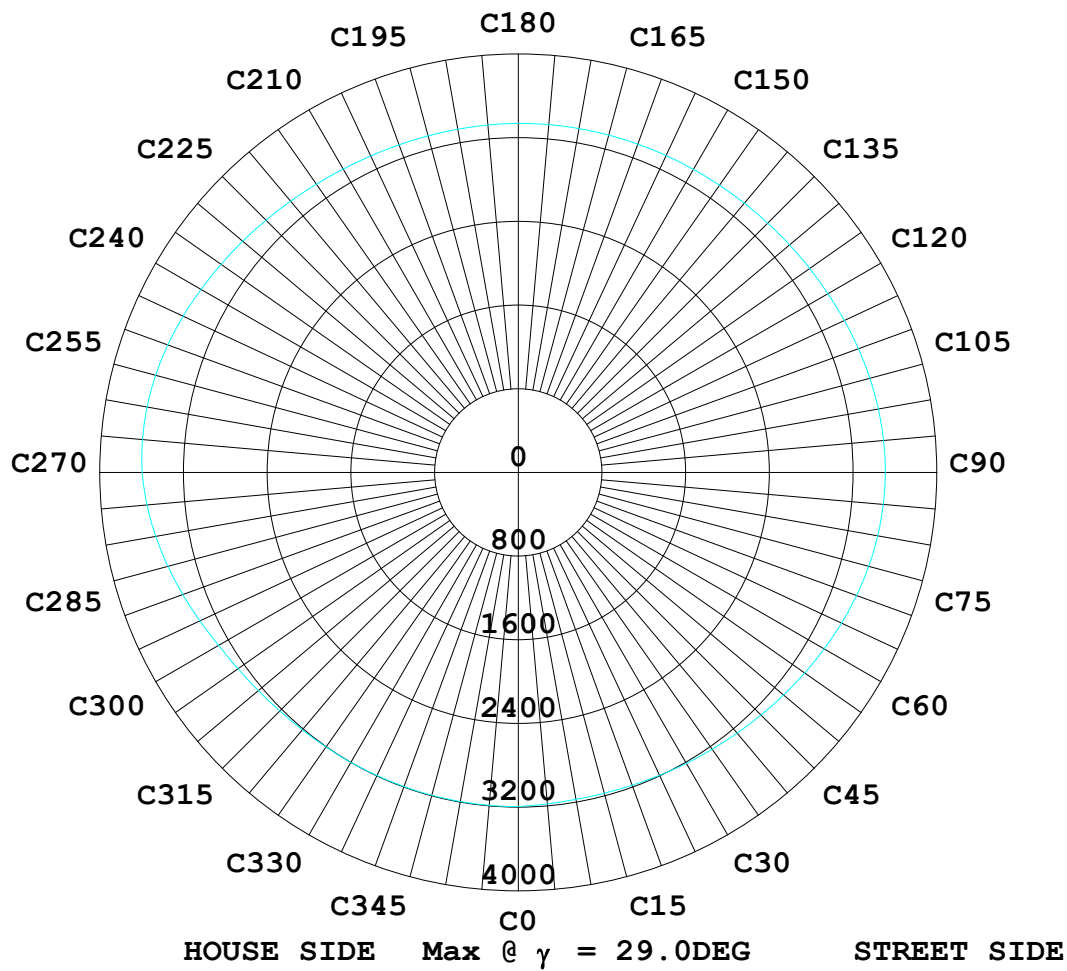

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:2022年09月16日

Test Set: 10.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:11.000 m
Remarks: